







## WIRELESS

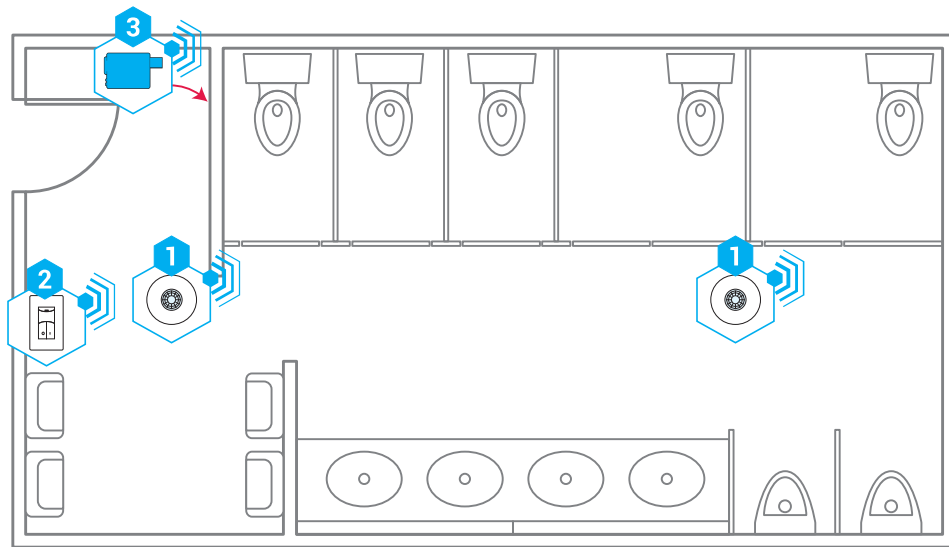

### KEY

-  TO LINE VOLTAGE CONNECTIONS
-  WIRELESS CONNECTION

## BILL OF MATERIAL

DIAGRAM #	QTY	MODEL #	DESCRIPTION
	2	SWX-221-B	Wireless Dual Technology (PIR/Acoustic) Occupancy Sensor, Small Motion, Ceiling Mount 360°
	1	SWX-852-B-xx	Wireless Remote On/Off Wall Station, <xx = color>
	1	SWX-950	Wireless Power Pack Controller, 120/277 VAC

## SEQUENCE OF OPERATION

1. Lighting switched on automatically to full bright.
2. On/off manual control of lighting.
3. Lighting turns off automatically after occupants leave the space.

## ADDITIONAL DESIGN CONSIDERATIONS

## SUPPORTED CODE REQUIREMENTS

Occupancy Sensor Control  
**C405.2.1 & C405.2.1.1(1)**

Manual Control - Switch  
**C405.2.2.3**

Auto On to Full Allowed  
**C405.2.1.1.(2)**